


In this instance the return to the heat pump buffer should be connected to the lower side connection on the NRGZone.

This will collect the coolest returning water from the zones and increase the efficiency of the heat pump.

It will also permit the solid fuel appliance and the heat pump to operate together under controlled conditions




In this instance the return to the solid fuel stove should be connected to the middle side connection on the NRGZone.

This will collect any hotter bypassing water in the NRGZone and increase the performance of the stove by maintaining a return temperature above 55 C when controlled by the built-in pipe thermostat in the NRG Link.

It will also permit the solid fuel appliance and the heat pump to operate together under controlled conditions.

Minimum 400mm

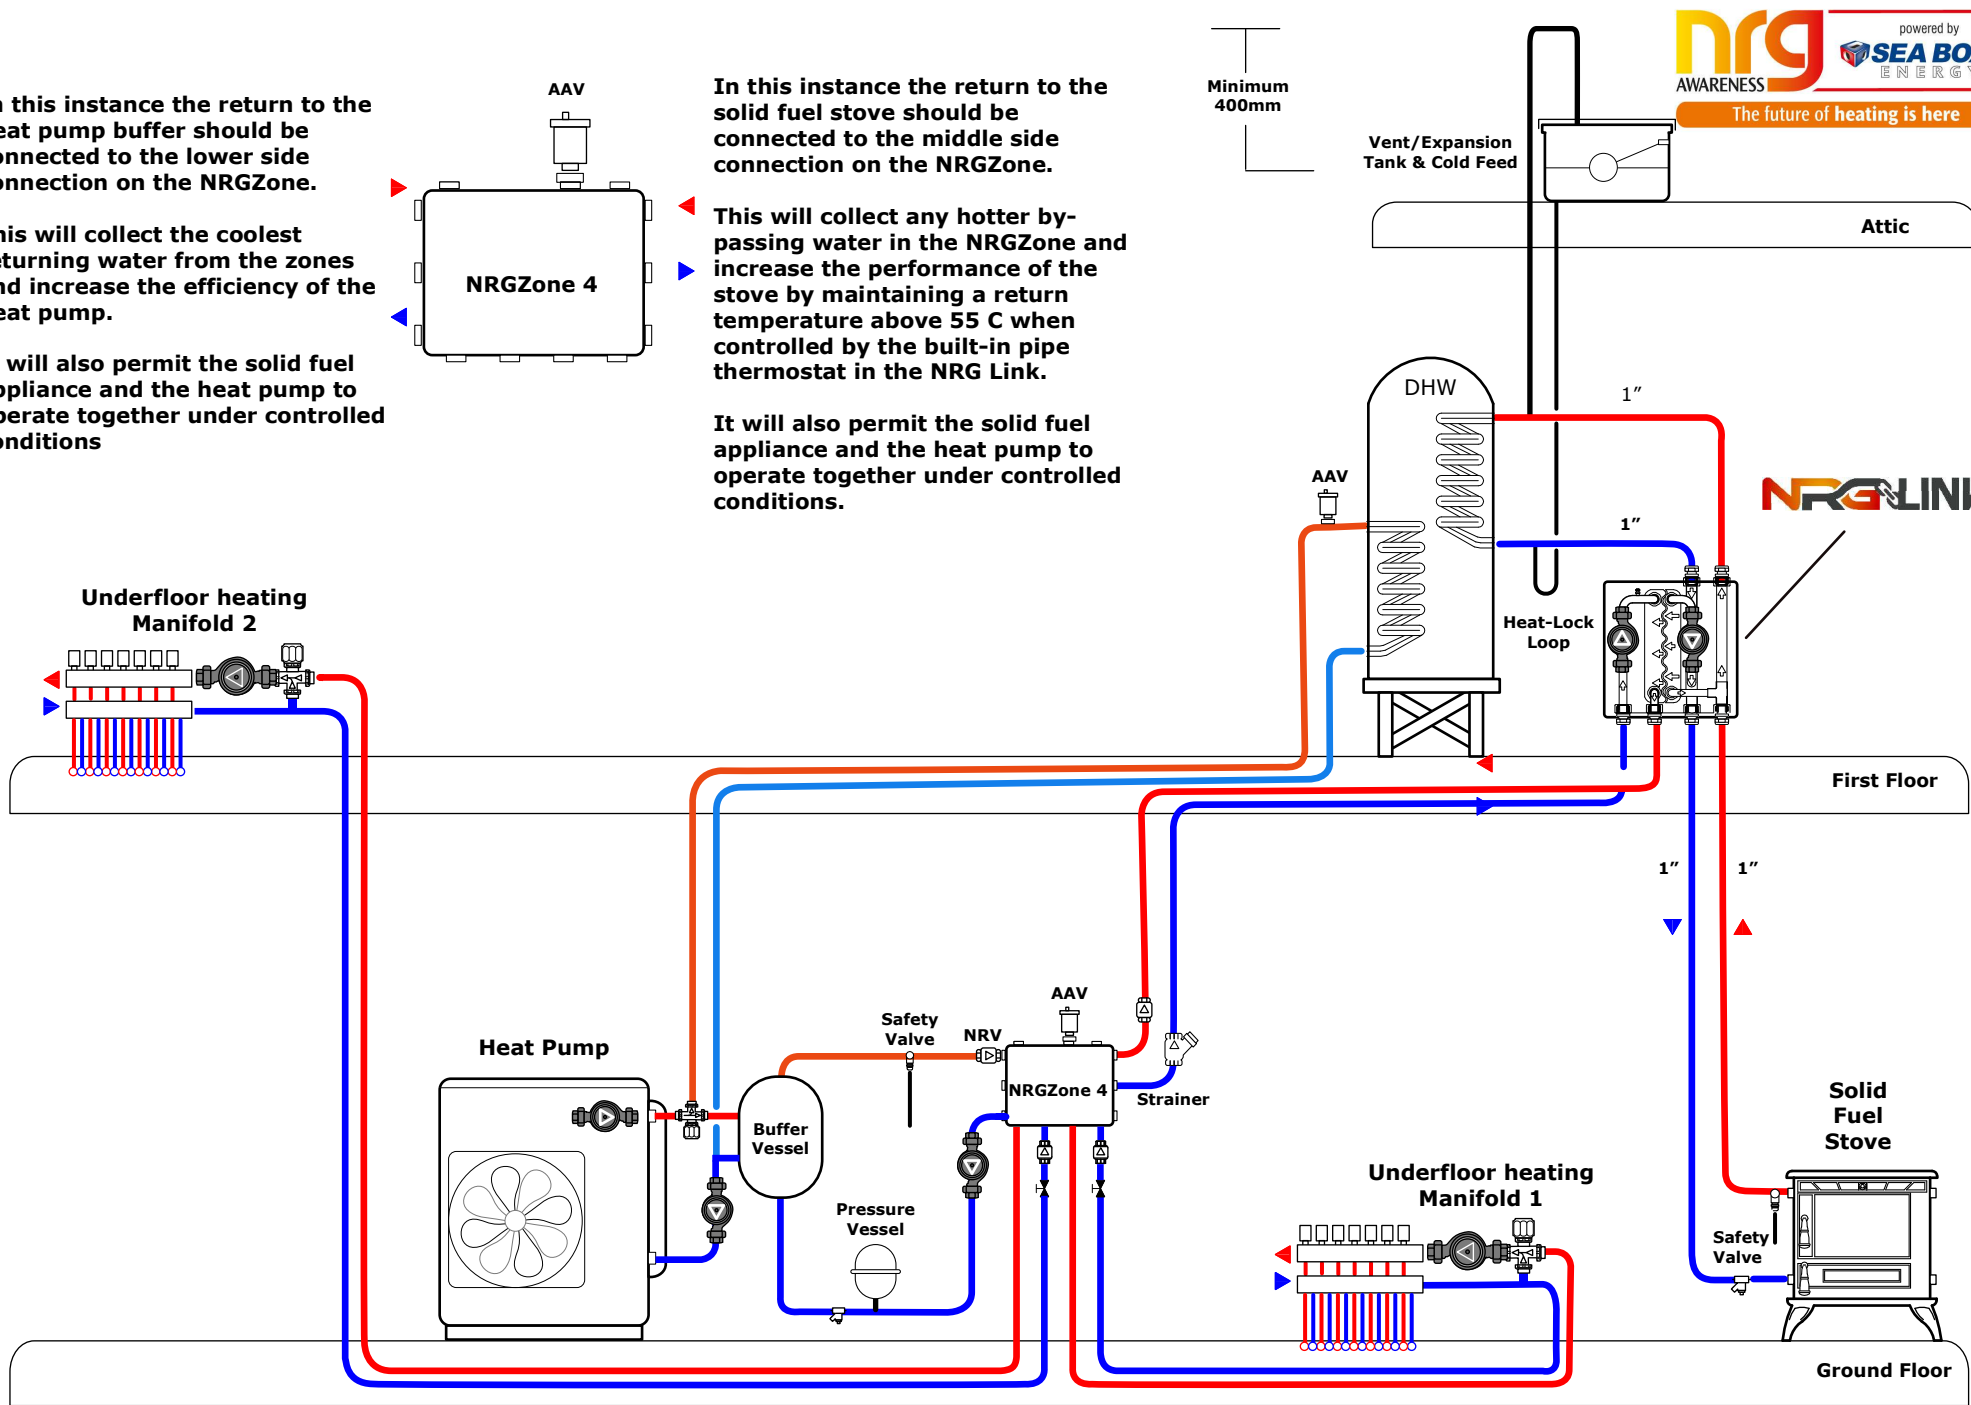

©